




technical data flag

	Ref.				White & Colors		Weight	Cap.
		A	B	C	$\Delta t=50^{\circ}\text{C}$	$\Delta t=30^{\circ}\text{C}$		
		mm	mm	mm	W	W		
840 9 elements elemente éléments elementos	FA084050	840	500	50	370	200	7,7	3,5
1140 12 elements elemente éléments elementos	FA114050	1142	500	50	525	284	11,2	5,1
1450 15 elements elemente éléments elementos	FA144050	1448	500	50	640	347	13,8	6,3
1750 18 elements elemente éléments elementos	FA175050	1752	500	50	740	401	17,1	7,8

$$\text{kcal/h} = 0,86 \times \text{Watt}$$


Wall fastening systems

Befestigungssysteme an der Wand
Systèmes d'installation murale
Sistemas de fijación a la pared

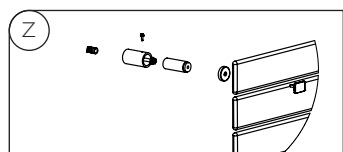


Radiator body dimensions


Größe des Heizkörpers
Dimensions du corps chauffant
Dimensiones del cuerpo calefactor

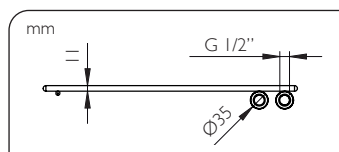


Measures in mm: A=height B=width C=interaxis
Abmessungen in mm: A=Höhe B=Breite C=Achsabstand
Mesures en mm: A=hauteur B=largeur C=entraxe
Medidas en mm: A=altura B=ancho C=entre eje

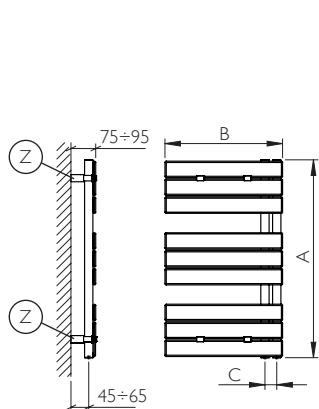


Mod. FA08...

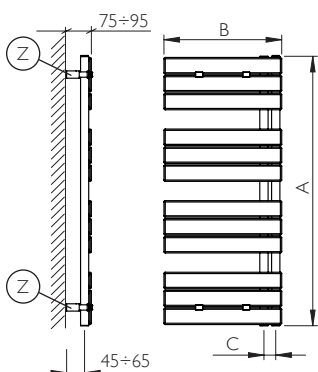

Mod. FA11...

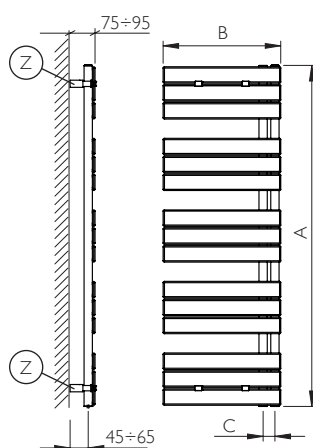

Mod. FA14...

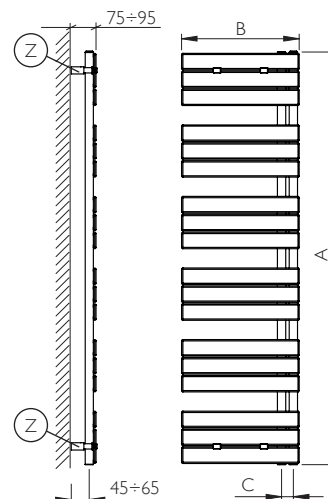

Mod. FA17...

technical notes

Maximum operating temperature: 90 °C

Max. Betriebstemperatur: 90° C

Température maximum de fonctionnement: 90 °C

Temperatura máx de funcionamiento: 90 °C

Maximum operating pressure: 400 kPa

Max. Betriebsdruck: 400 kPa

Pression maximum de fonctionnement: 400 kPa

Presión máx de funcionamiento: 400 kPa



Wall fastening systems are white for "9010" version, chromed for "colors" versions

Die Befestigungselemente sind für die Ausführung "9010" weiß und für Ausführungen "colours" verchromt

Les systèmes d'installation sont blanc pour la version "9010", chromés pour les versions "colors"

Los sistemas de fijación son blancos para la versión "9010", cromados para las versiones "colors"

For single pipe installation, please consult technical notes Pag. 163

Bei dem Einrohrsystem lesen Sie die technischen Daten auf Seite 165

Pour installation monotube consulter les renseignements techniques détaillés Pag. 167

Para instalaciones monotubo consulte las informaciones técnicas detalladas Pag. 169